

Drought Response Level 1
Public Information Campaign

October 18, 2019

Greene County is currently under a **Drought Response Level 1**
which is the **least severe** and level 3 being the most severe.


What factors go into this declaration by the Georgia State Environmental Protection division:

- | | |
|---------------------|-----------------------------------|
| 1. Precipitation, | 5. Soil Moisture |
| 2. Stream Flow | 6. Short Term Climate Predictions |
| 3. Groundwater | 7. U.S. Drought Monitor |
| 4. Reservoir Levels | 8. Water Supply Conditions |

What do I need to do as a water customer, consumer?

1. Help conserve water whenever and however you can.
2. Pay close attention to drought factors and understand that it may be that the EPD will place Greene County under a more restrictive **level 2** designation. If that happens, a public notice will be posted here at the Library and one will be placed in the local paper.
3. For more information. Call The City of Greensboro Water Treatment Plant Manager Lamar Callaway 706-453-2782 or <http://epd.georgia.gov/water-conservation>

Area for Drought Response October 18, 2019

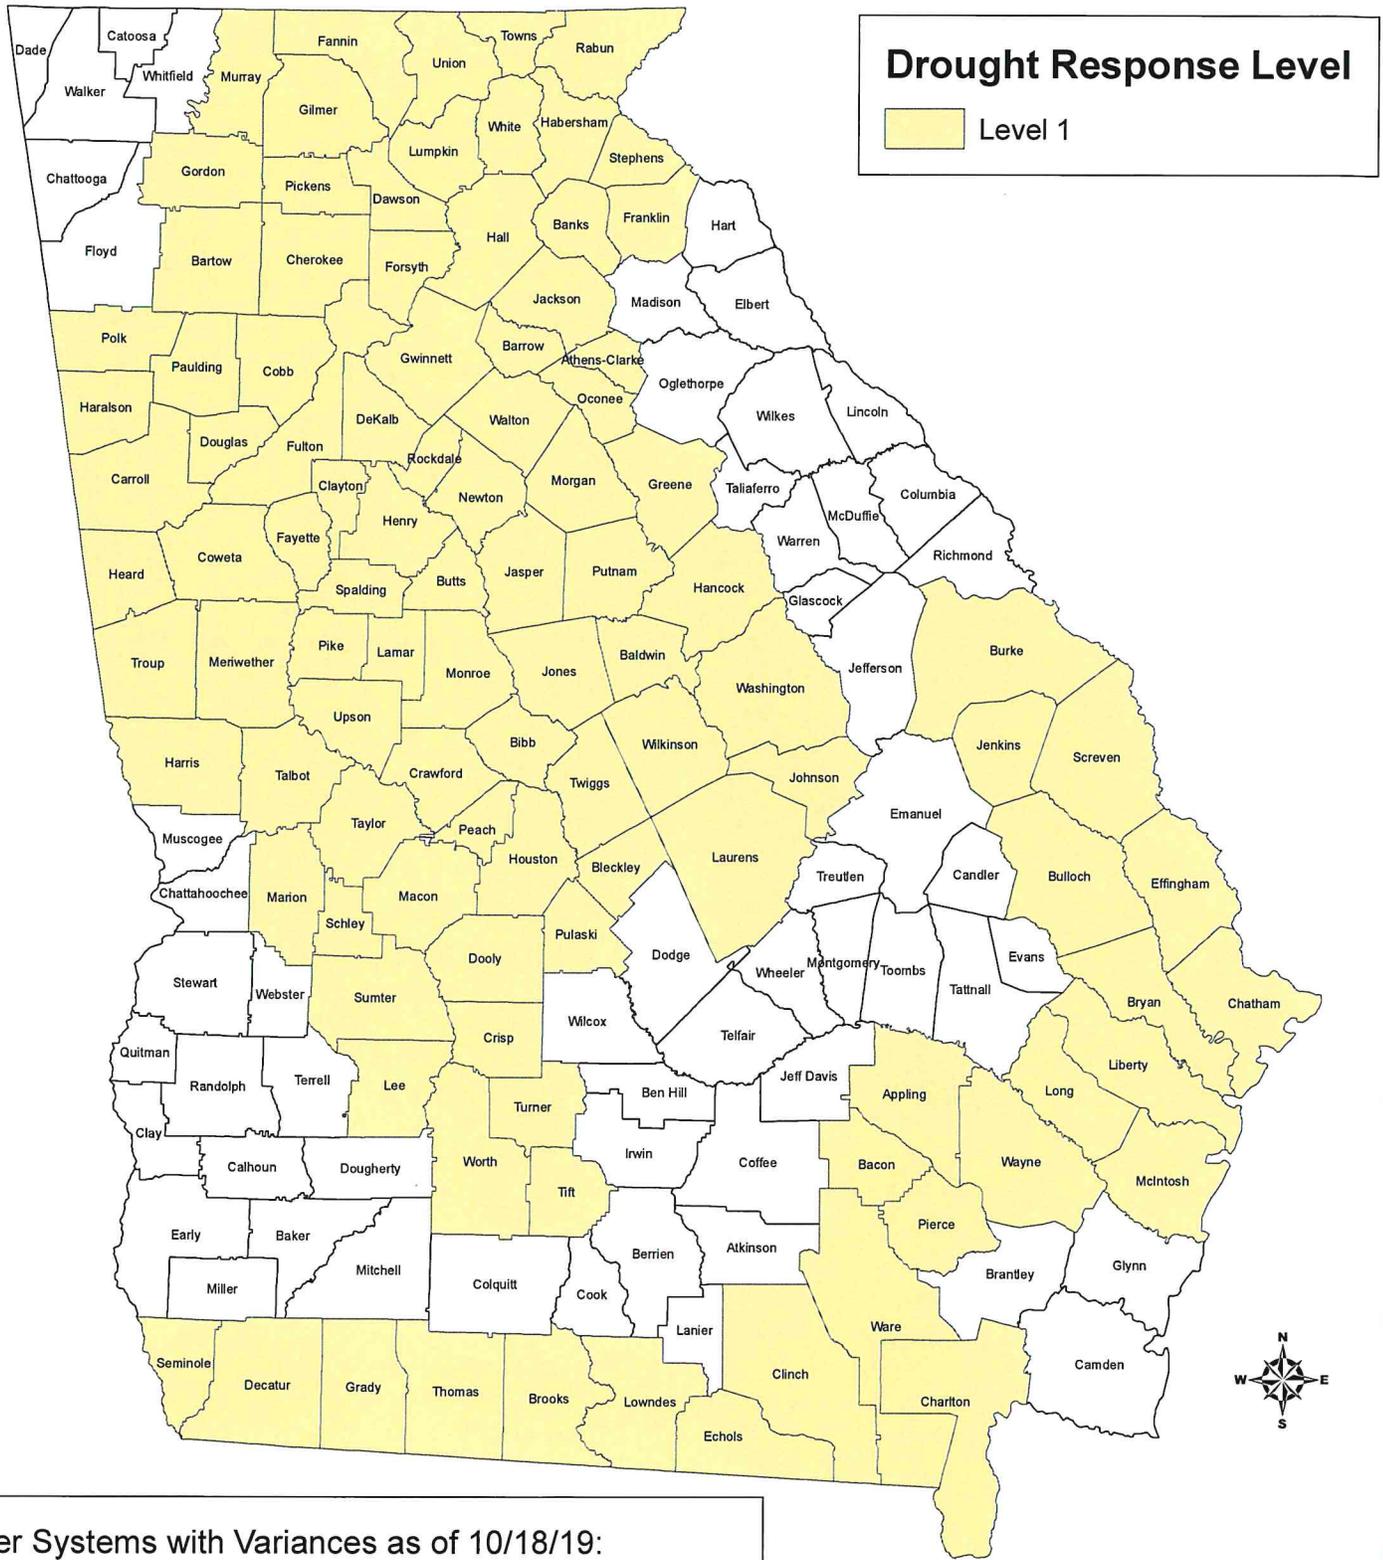

Drought Response Level

Level 1



Water Systems with Variances as of 10/18/19:

Coweta County Water and Sewerage Authority (DRL 2)
City of Griffin (DRL 2)

